



# Cascade Creek GT Unit 1 Event Report

# Cascade Creek Gas Turbine 1

- June 1, 2025
- GT1 Scheduled to run from 14:00 to 22:00
- GT1 Start Command at 13:25
- GT1 Tripped at 19:09 high fuel oil pump temperature
- Exhaust Fire Alarm 22:00
- Operator to Site 22:17
- Call to RFD 23:02
- RFD on site 23:05






# Cascade Creek Gas Turbine 1


- Unit sustained substantial damage
- It has been placed in forced outage awaiting reports from RFD and Insurance Company
- Site cleanup initiated immediately
- RPU team is working to determine repair/replace options




# Cascade Creek Gas Turbine 1

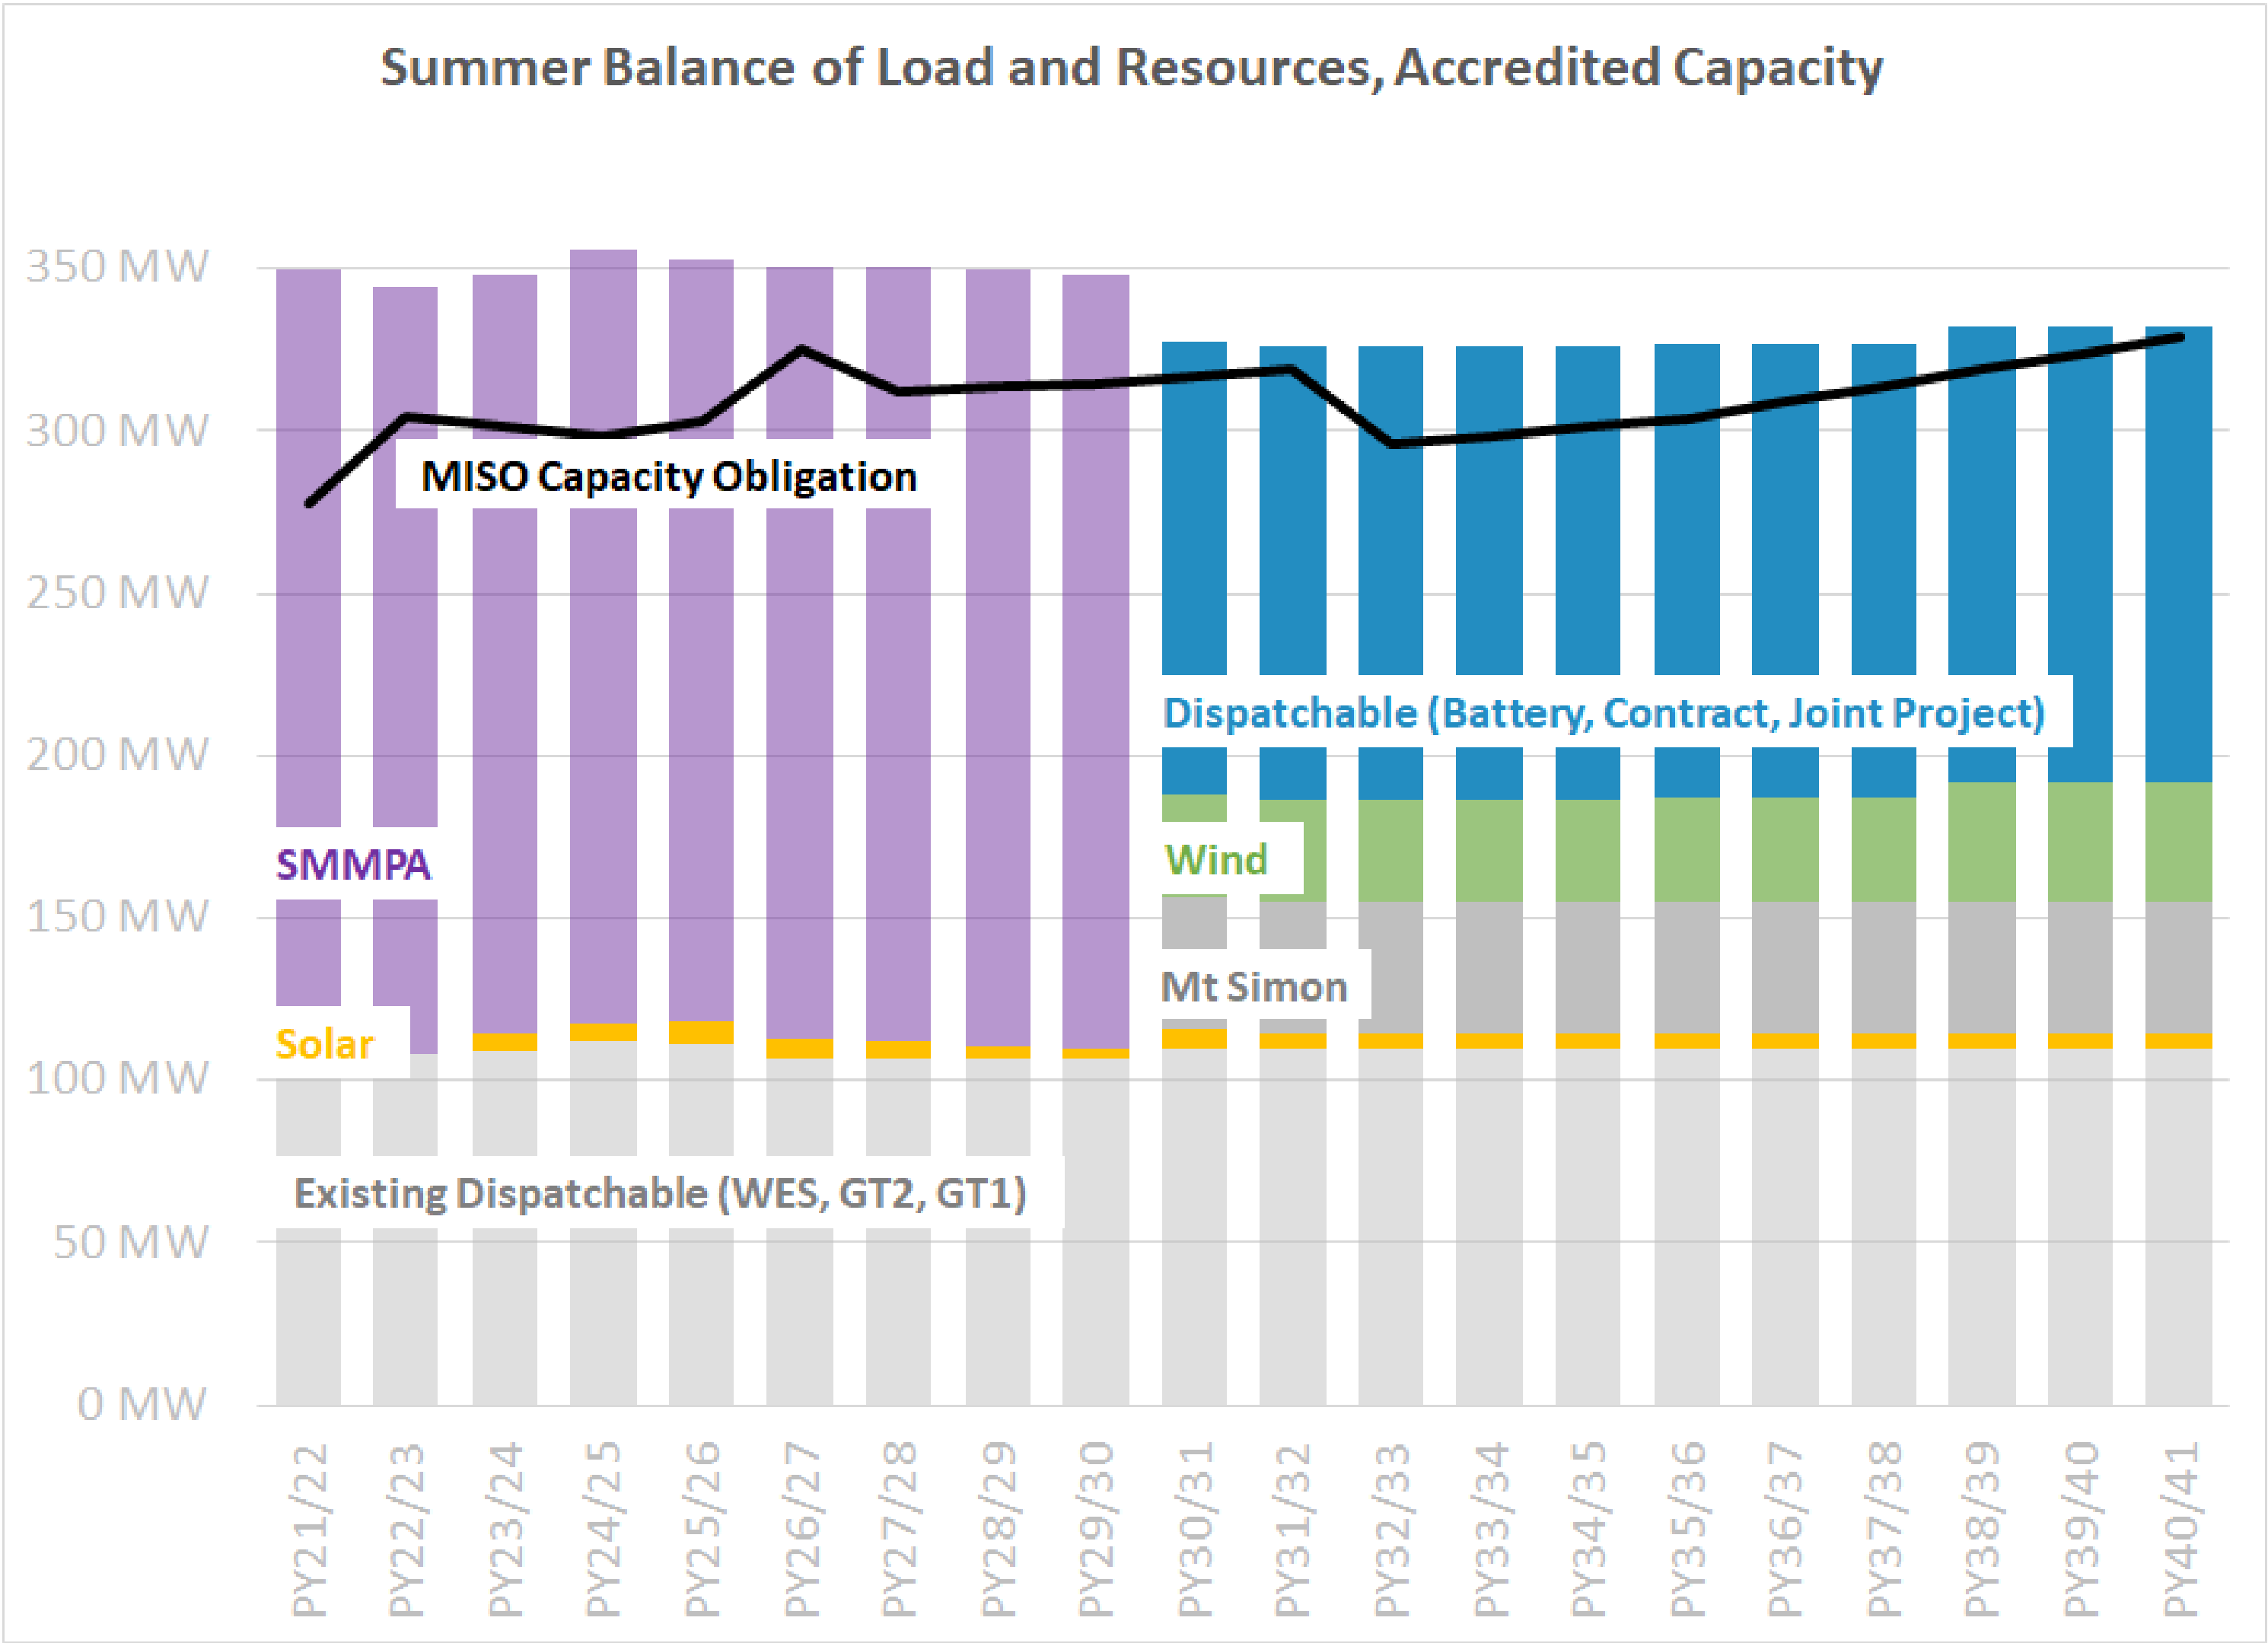


# Cascade Creek Gas Turbine 1

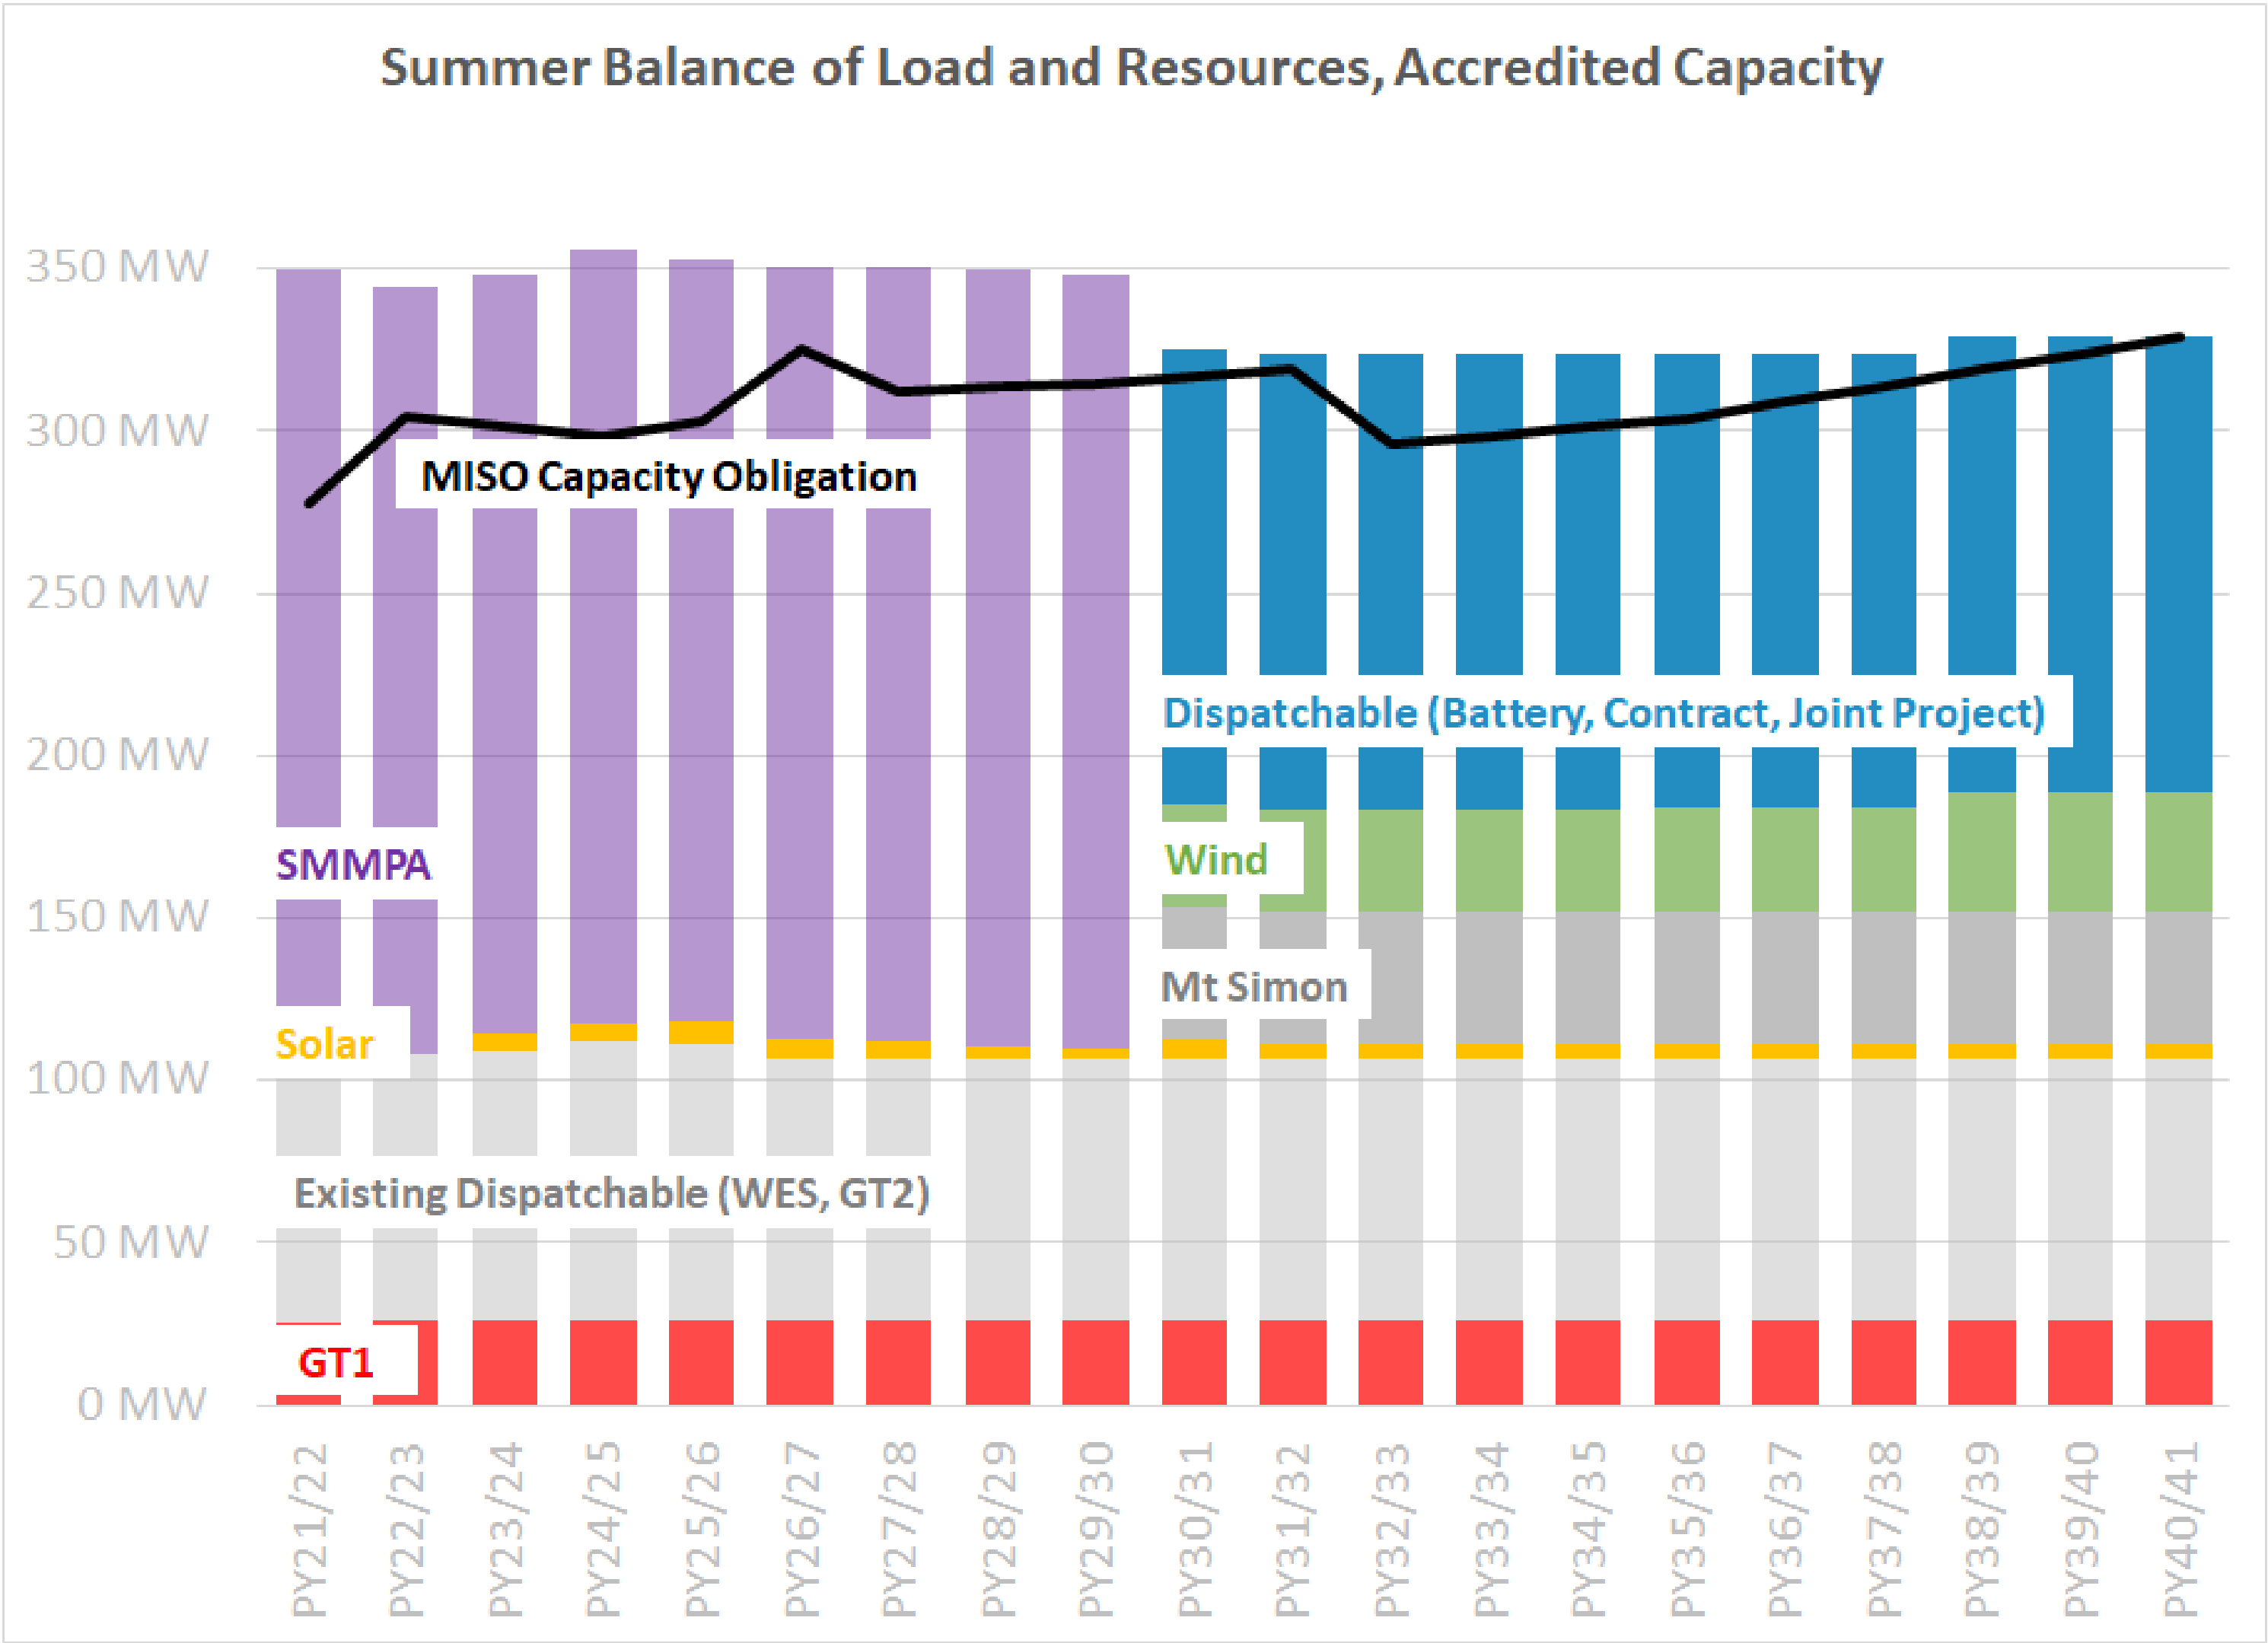

# Cascade Creek Gas Turbine 1

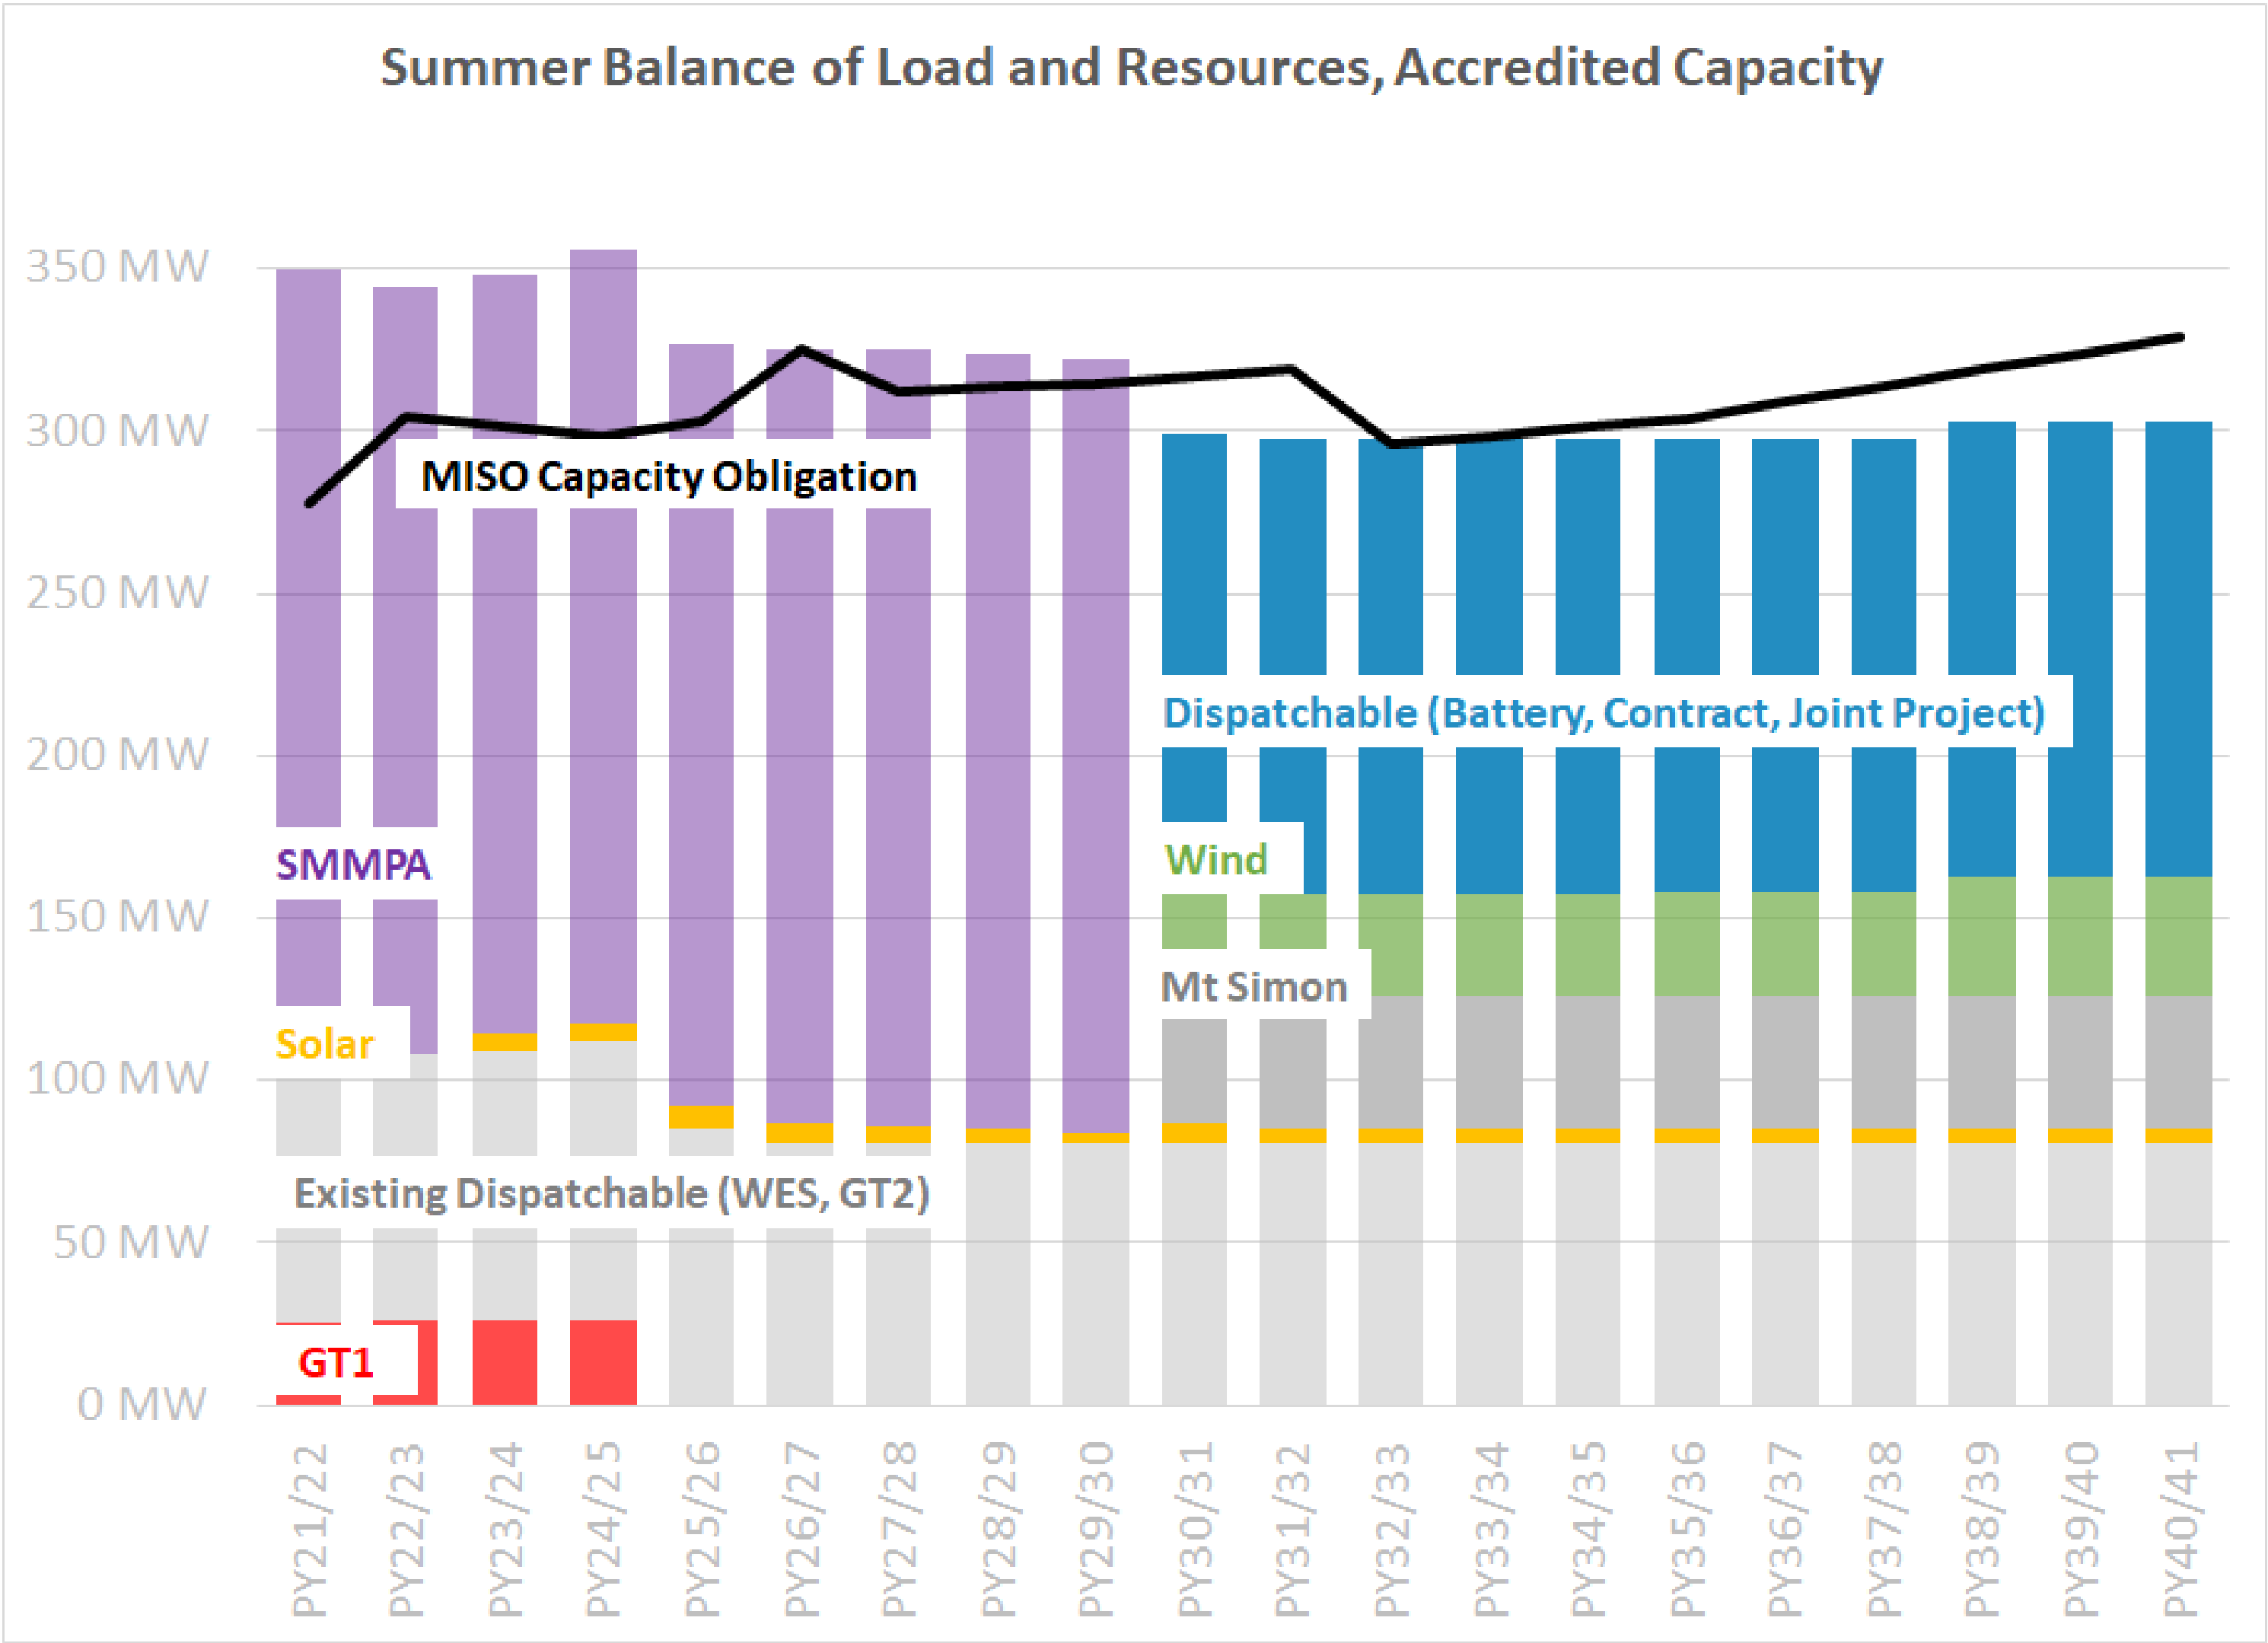

# Cascade Creek Gas Turbine 1

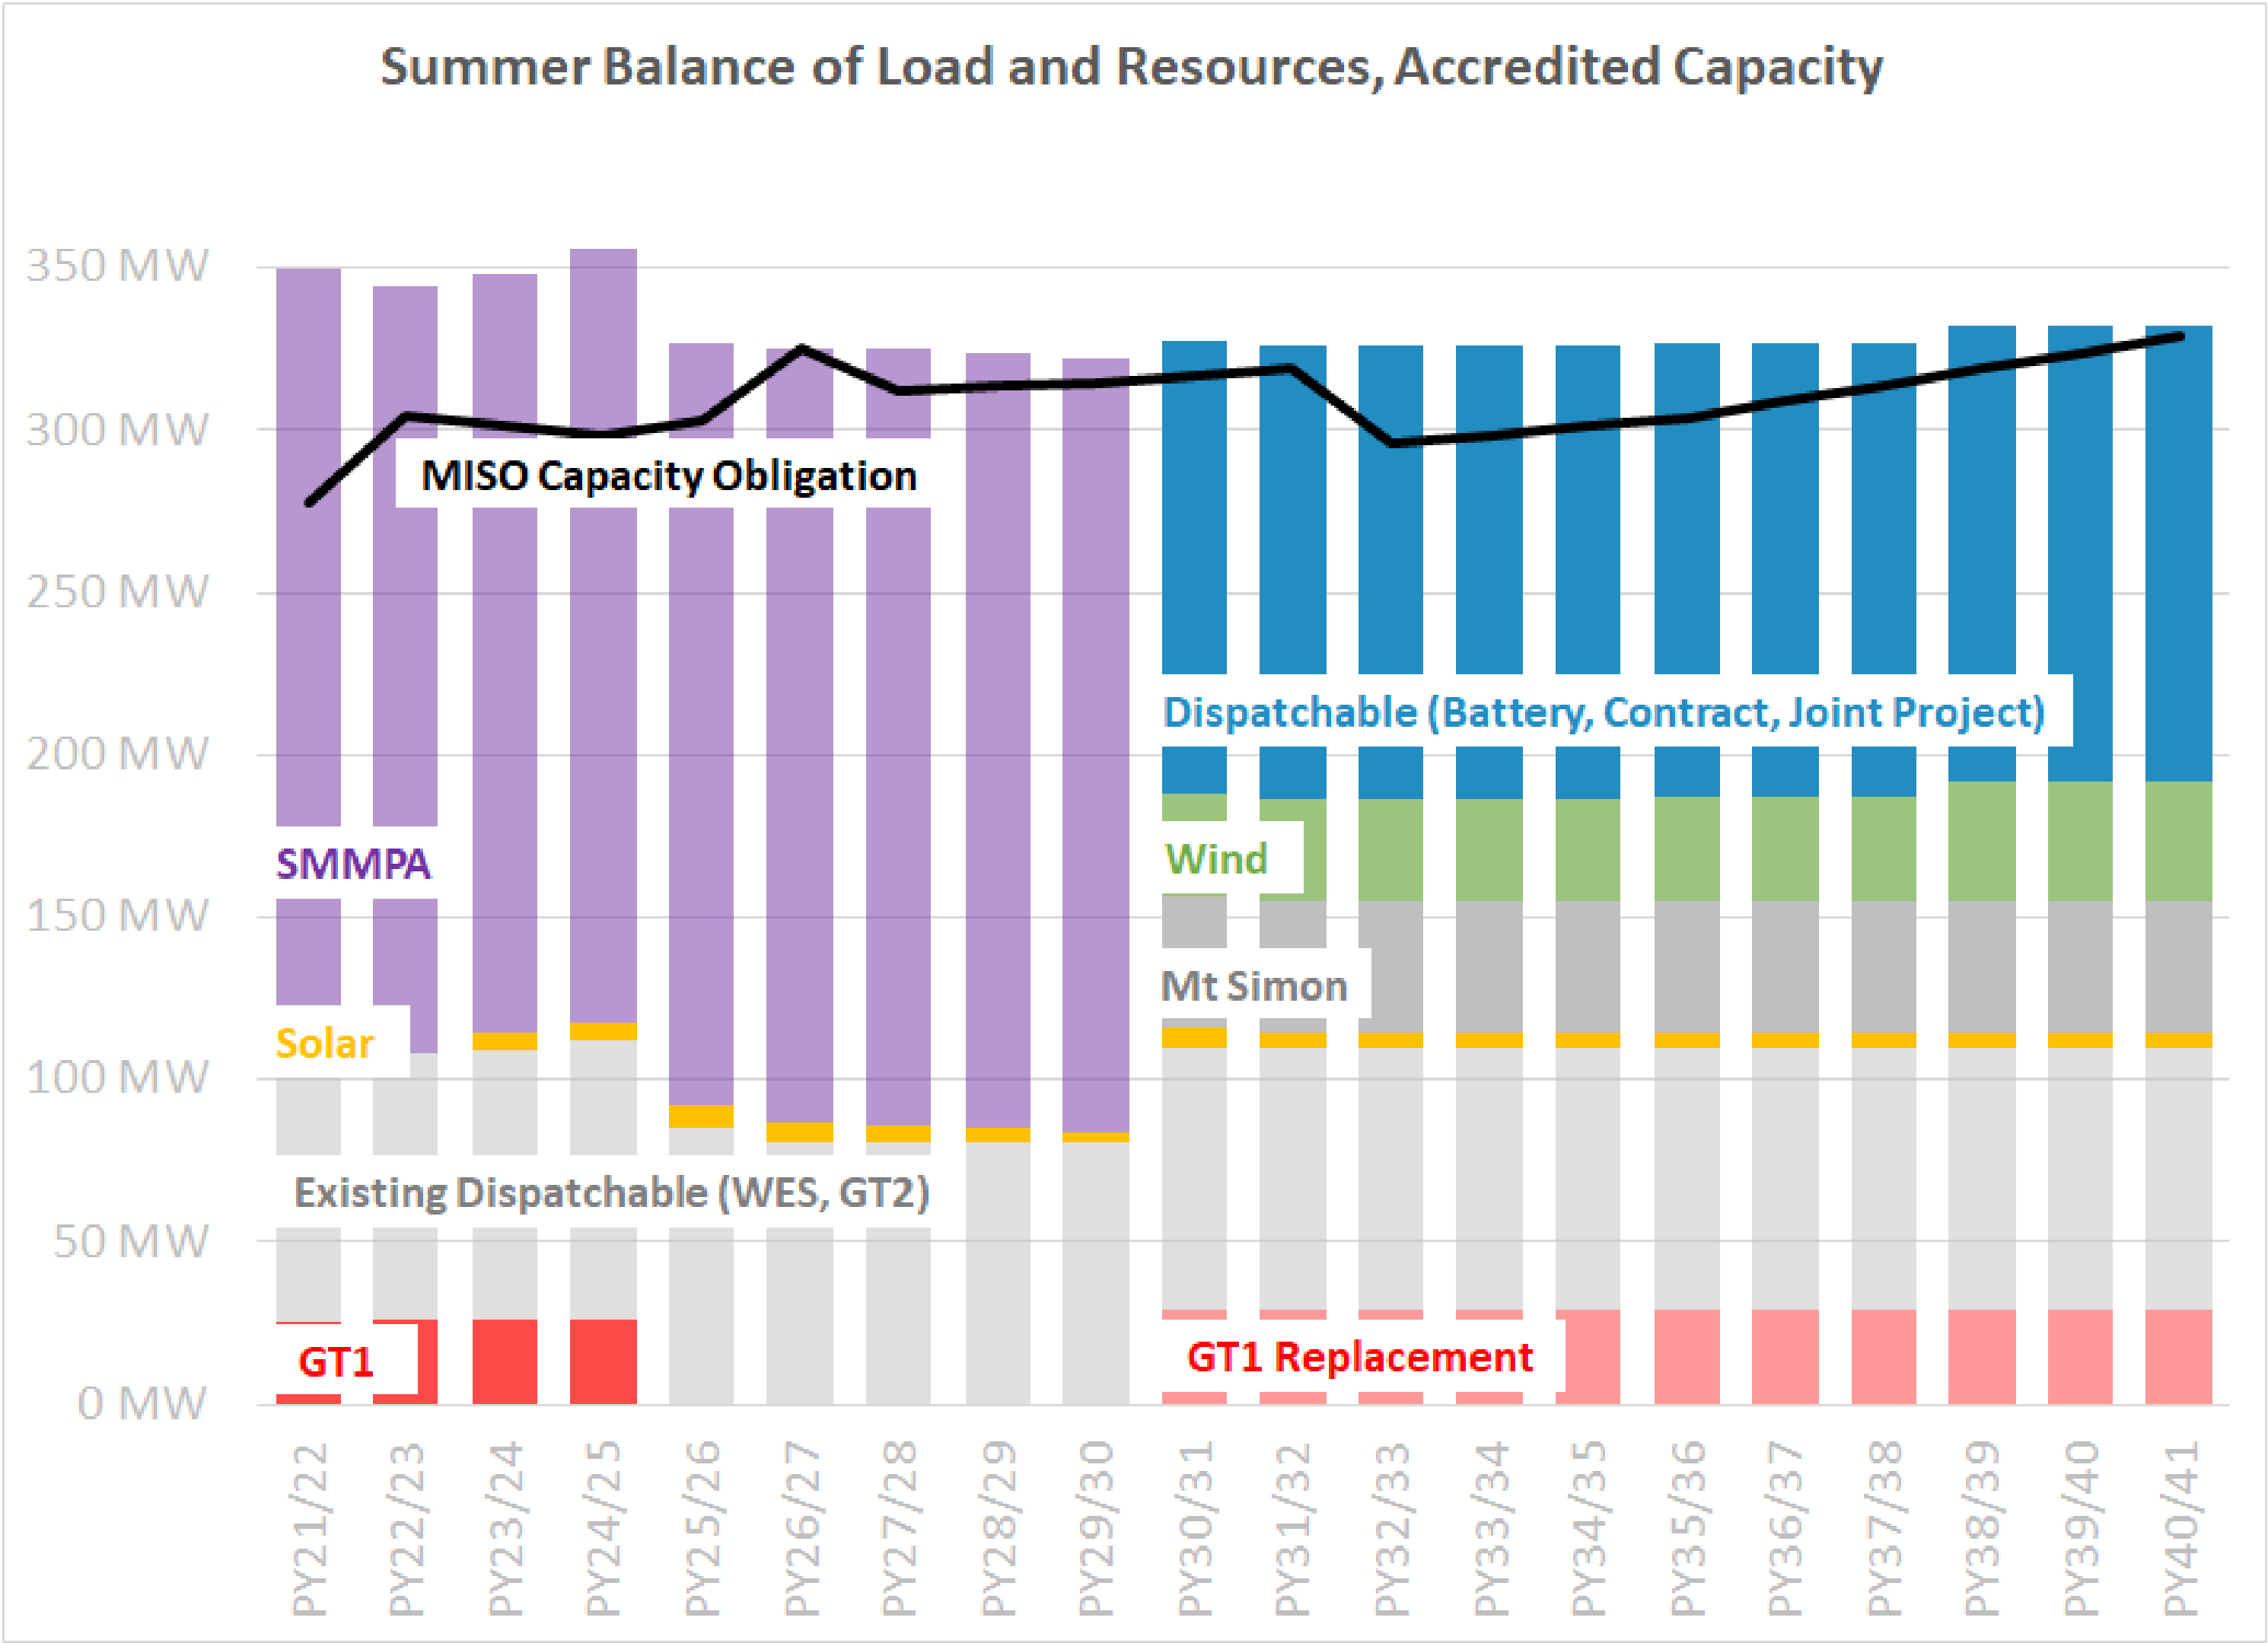

**Click to Edit Text**